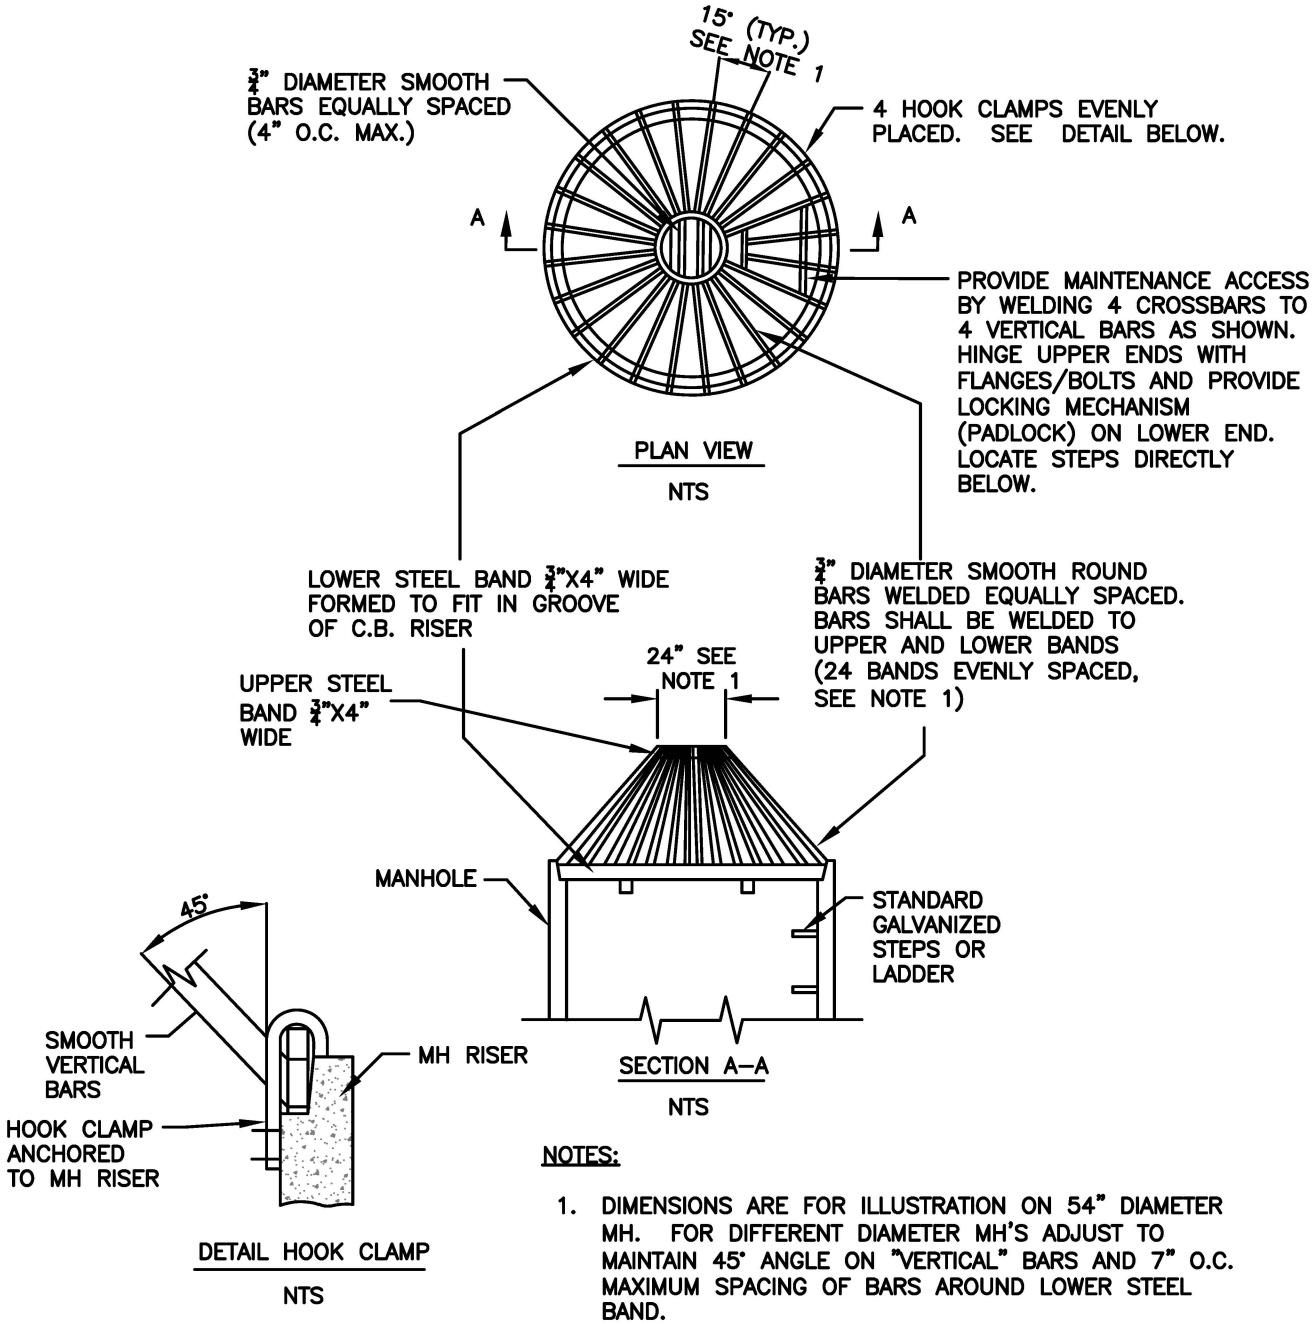


NOTES:

1. DIMENSIONS ARE FOR ILLUSTRATION ON 54" DIAMETER MH. FOR DIFFERENT DIAMETER MH'S ADJUST TO MAINTAIN 45° ANGLE ON "VERTICAL" BARS AND 7" O.C. MAXIMUM SPACING OF BARS AROUND LOWER STEEL BAND.
2. METAL PARTS MUST BE CORROSION RESISTANT; STEEL BARS MUST BE GALVANIZED.
3. REFER TO VOLUME III OF THE STORMWATER MANAGEMENT MANUAL FOR WESTERN WASHINGTON FOR MORE INFORMATION.

N.T.S.

BIRDCAGE OVERFLOW STRUCTURE

STANDARD DETAIL

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

Mark Henrey 06/11/2018

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	12/29/16	KDU	KDU
2	03/19/18	CAS	KDU

ST–9.02