



N:\CAD Data\Standard Dwgs\Sanitary Sewer Details\SS-3.1_6-InchLateralConnect.dwg 3/28/2007 2:41:18 PM

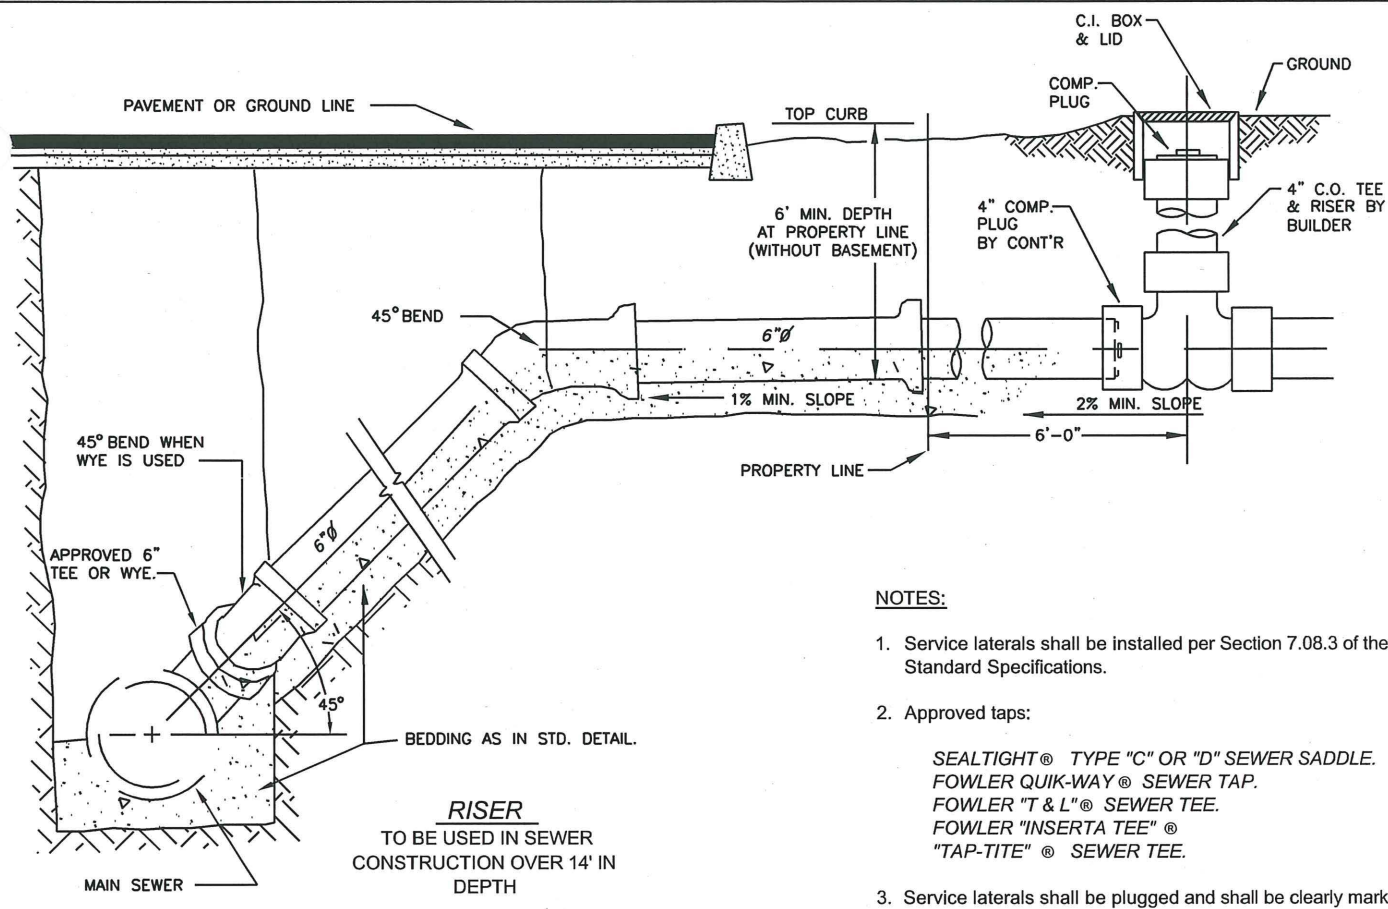


NOTES:

1. Service laterals shall be installed per Section 7.08.3 of the Standard Specifications.
2. Approved taps:
 SEALTIGHT® TYPE "C" OR "D" SEWER SADDLE.
 FOWLER QUIK-WAY® SEWER TAP.
 FOWLER "T & L"® SEWER TEE.
 FOWLER "INSERTA TEE"®
 "TAP-TITE"® SEWER TEE.
3. Service laterals shall be plugged and shall be clearly marked w/10" 2"x4", and shall be extended 6 feet behind street right-of-way, and wrapped w/10-ga. wire.
4. Transitions between dissimilar pipe materials or sizes shall be made with approved adaptors (Fernco, Caulder or Equal).
5. Install a cleanout at the property line.
6. Shall be used for non-single family residences.

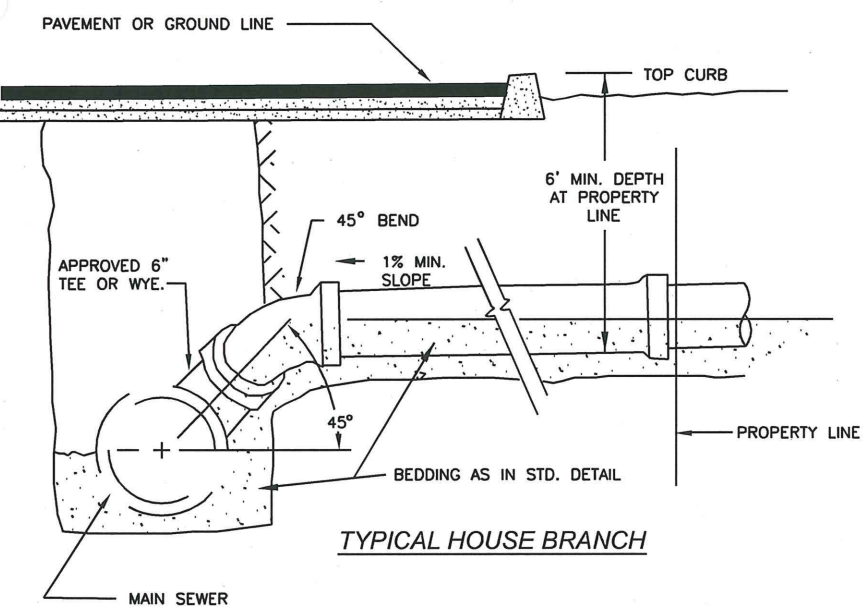

SIX-INCH LATERAL CONNECTION

PLAN #



CITY OF BATTLE GROUND APPROVED

Sam Adams 3-29-07
 CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	8/12/98	BSG	GGH
2	8/30/05	ALL	MCH
3	3/28/07	JMH	MCH

SS-3.1