
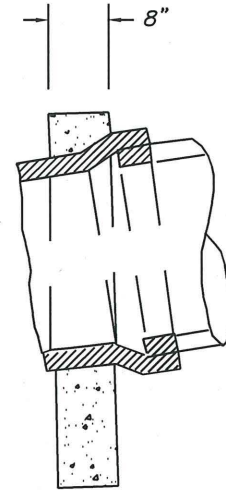


N:\CAD Data\Standard Dwgs\Sanitary Sewer Details\SS-4.4_Anchor Wall.dwg, 3/28/2007 2:09:19 PM

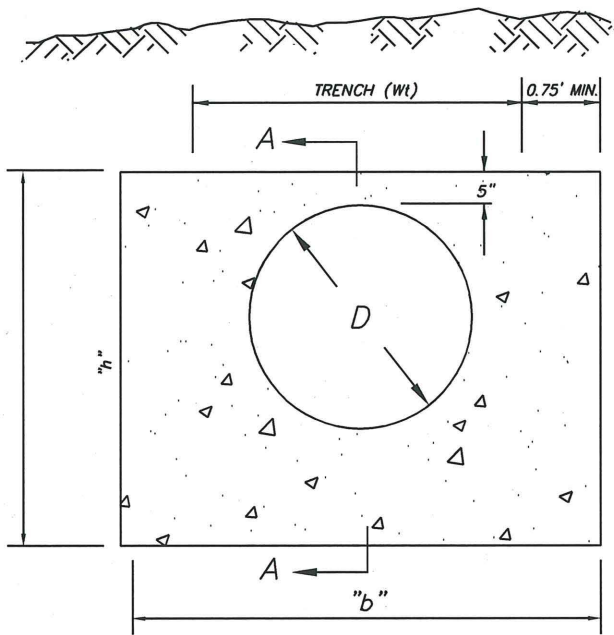

SECTION A-A

NOTES:


1. ALL CONCRETE TO BE 3000 P.S.I., 2" TO 4" SLUMP.
2. WALLS WILL BE PLACED WHERE GRADE IS 20% OR OVER.
3. ANCHOR WALLS TO BE EQUALLY SPACED WITH MAXIMUM DISTANCE BETWEEN WALLS TO BE AS SHOWN IN TABLE "A".
4. PLACE WALL IMMEDIATELY BELOW BELL OF PIPE WHERE POSSIBLE.
5. CONCRETE SHALL BE POURED AGAINST FORMS OR STABLE UNDISTURBED SOIL.

TABLE "A"		
SLOPE %		MAXIMUM ALLOWABLE SPACING (FT.) (MEASURED ON SLOPE)
OVER	TO	
20	35	36'
35	50	24'
50	100	16'

TABLE "B"				
PIPE SIZE (D)	TRENCH WIDTH MAX. (Wt)	h	b	VOLUME OF CONCRETE (APPROX.)
6", 8", 10"	2.5'	3.0'	4.0'	0.29 C.Y.
12", 15"	2.5'	4.0'	4.0'	0.37 C.Y.
18", 21", 24"	3.5'	4.0'	5.0'	0.42 C.Y.
30", 36"	4.5'	5.0'	6.0'	0.62 C.Y.

ANCHOR WALL DETAIL

PLAN #



CITY OF BATTLE GROUND APPROVED

John Adams 3-28-07
CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	8/12/98	BSG	GGH
2	3/28/07	JMH	MCH

SS-4.4