

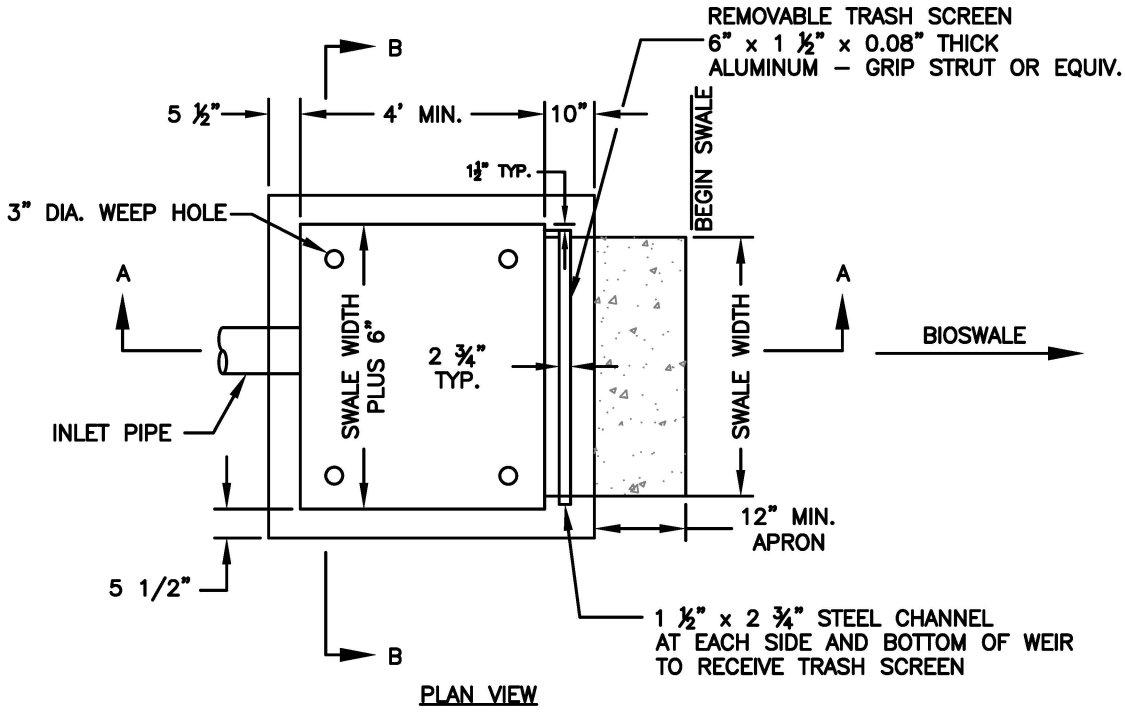


PLAN VIEW

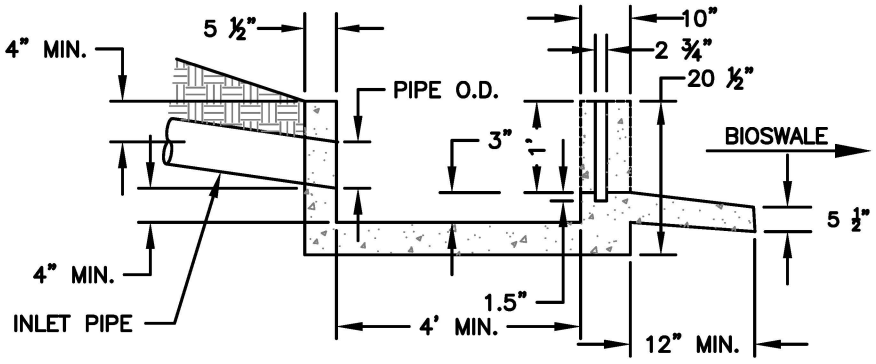

SECTION A–A

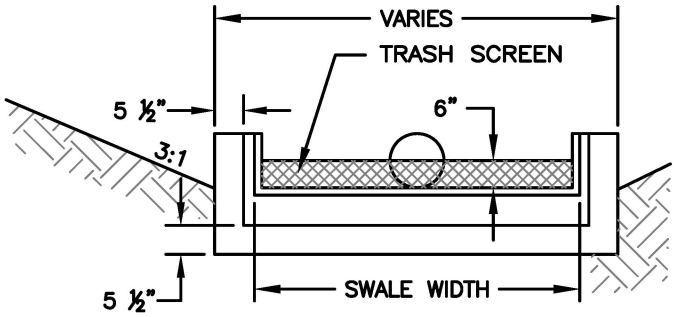

SECTION B–B

NOTE:

1. CONCRETE SHALL BE 3000 PSI MIN. MEETING WSDOT STANDARD SPECIFICATIONS 6–02.3(2)B.
2. BIOSWALE SEDIMENTATION TRAP IS REQUIRED WITH ALL BIOSWALES, UNLESS OMISSION IS APPROVED BY CITY ENGINEER.

N.T.S.

BIOSWALE SEDIMENTATION TRAP

STANDARD DETAIL

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

Mark Henry 06/11/2018

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	7/22/09	RMJ	RMJ
2	3/22/18	CAS	KDU

ST–6.02