
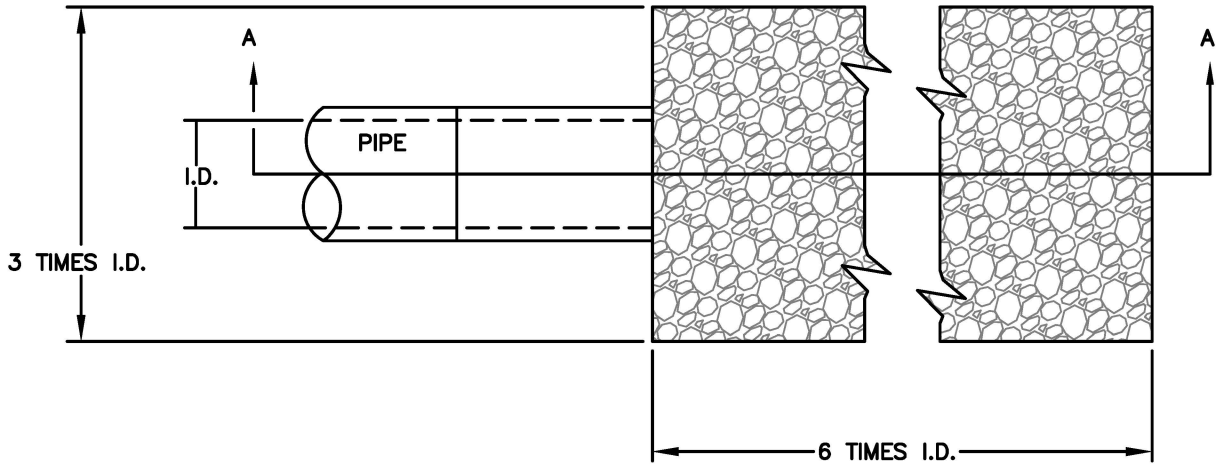


PLAN VIEW

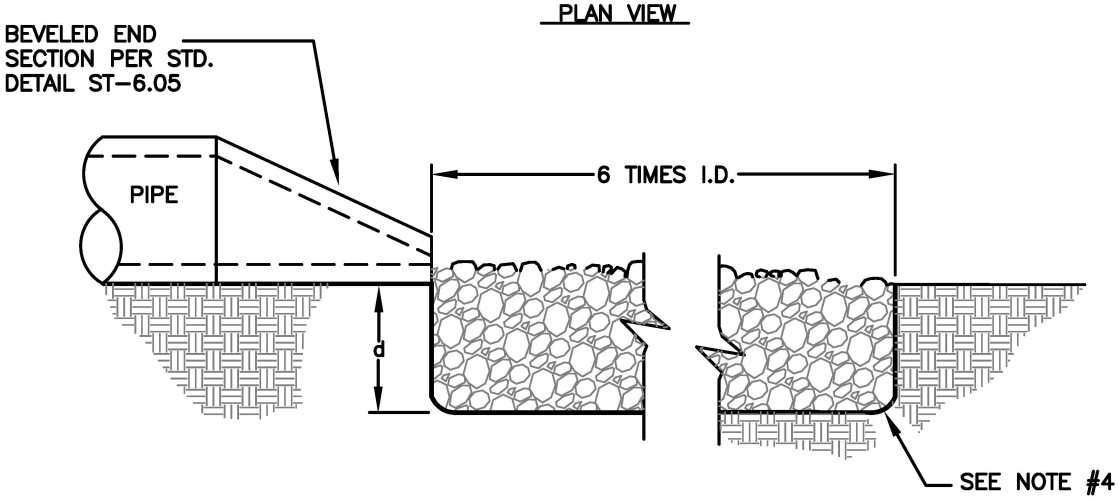

SECTION 'A-A'

NOTES:

1. ROCK MATERIAL SHALL BE BETWEEN 3" AND 8" AND INSTALLED PER WSDOT 9-13.1.
2. d = 1.5 TIMES THE MAXIMUM STONE DIAMETER BUT NOT LESS THAN 4.5".
3. IN A WELL-DEFINED CHANNEL EXTEND RIP-RAP UP THE CHANNEL BANKS TO AN ELEVATION OF 6" ABOVE THE MAXIMUM TAILWATER DEPTH OR TO THE TOP OF THE BANK, WHICHEVER IS LESS.
4. A FILTER BLANKET OR FILTER FABRIC SHALL BE INSTALLED BETWEEN THE RIP-RAP AND SOIL FOUNDATION.

N.T.S.

RIP-RAP

STANDARD DETAIL

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

Mark Henrey

06/11/2018

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	7/22/09	RMJ	RMJ
2	3/31/17	CAS	KDU

ST-6.04