

NOTES:

1. EXISTING CURB AND SIDEWALK TO BE SAWCUT AND REMOVED FOR INSTALLATION OF NEW RAMPS.
2. RAMPS TO BE POURED SEPARATELY AND ISOLATED BY EXPANSION JOINT MATERIAL.
3. CURB AND RAMP DIMENSIONS MAY VARY TO MEET REQUIRED SLOPE.
4. DOUBLE RAMPS ALLOWED ONLY IF CURB RETURN RADIUS IS GREATER THAN OR EQUAL TO 25'.
5. IF THE AREA BEHIND THE SIDEWALK IS VEGETATED, THE BACK CURB MAY BE REPLACED WITH A SLOPE NO STEEPER THAN 4:1.

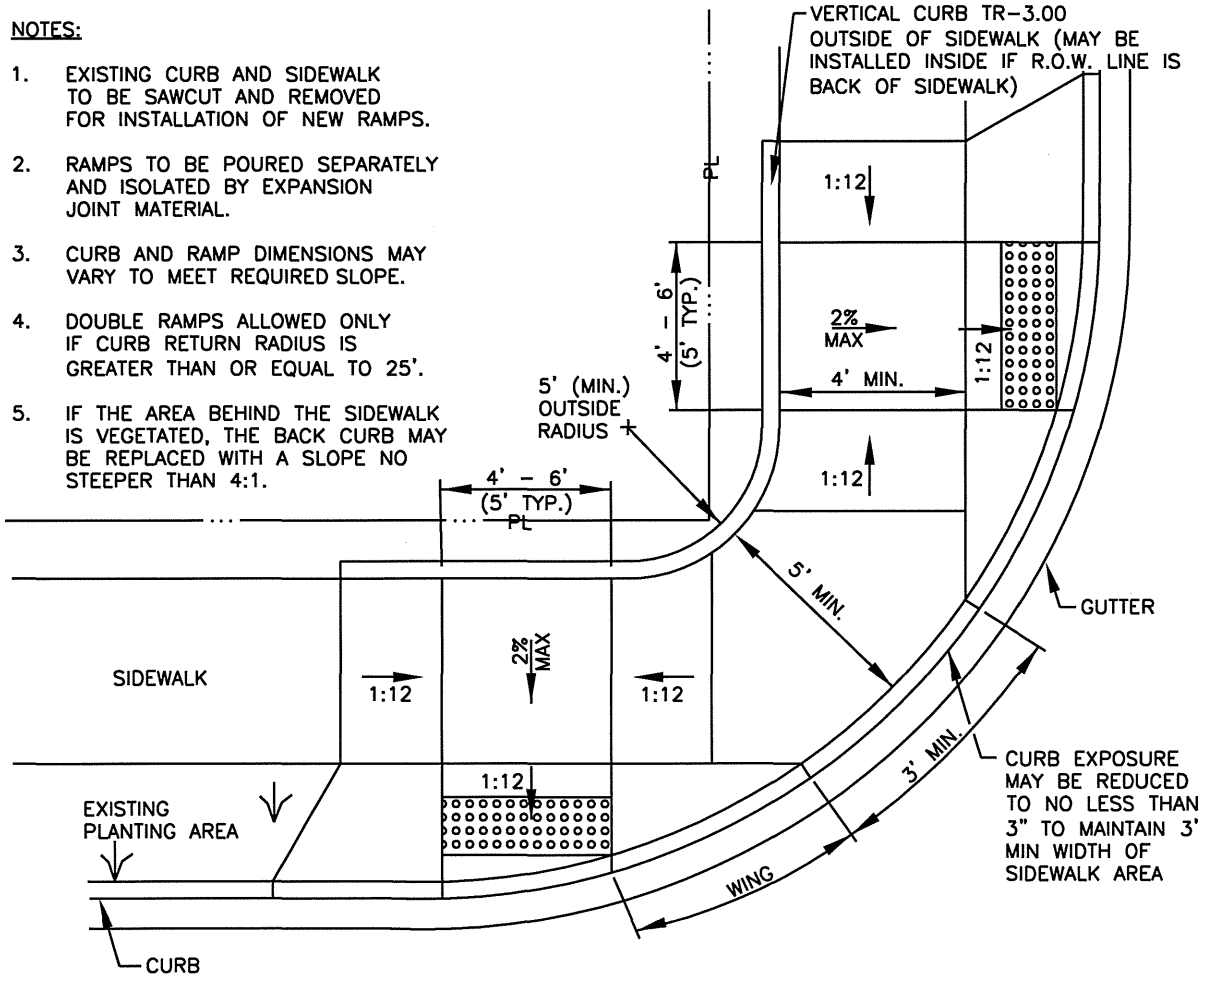


THIS TYPE OF RAMP IS ONLY TO BE USED IN EXISTING RESTRICTED RIGHT-OF-WAY AREAS AND WHEN APPROVED BY THE CITY ENGINEER.

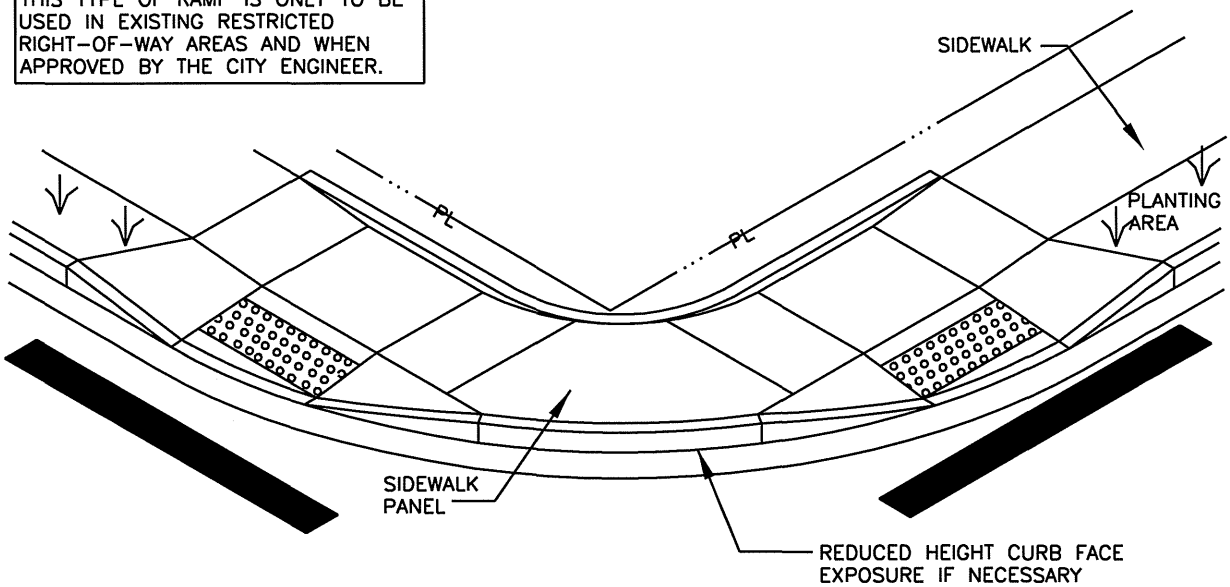


N.T.S.

# TYPE 3A CURB RAMP

PLAN #

CITY OF BATTLE GROUND
APPROVED

6/6/08

CITY ENGINEER DATE

| REVISIONS: | DATE: | DRAWN: | DESIGNED: |
|---|---|---|---|
| 1 | 9/14/07 | JMH | MCH |
| 2 | 6/6/08 | JMH | MCH |
| | | | |
| | | | |
| | | | |

TR-4.10