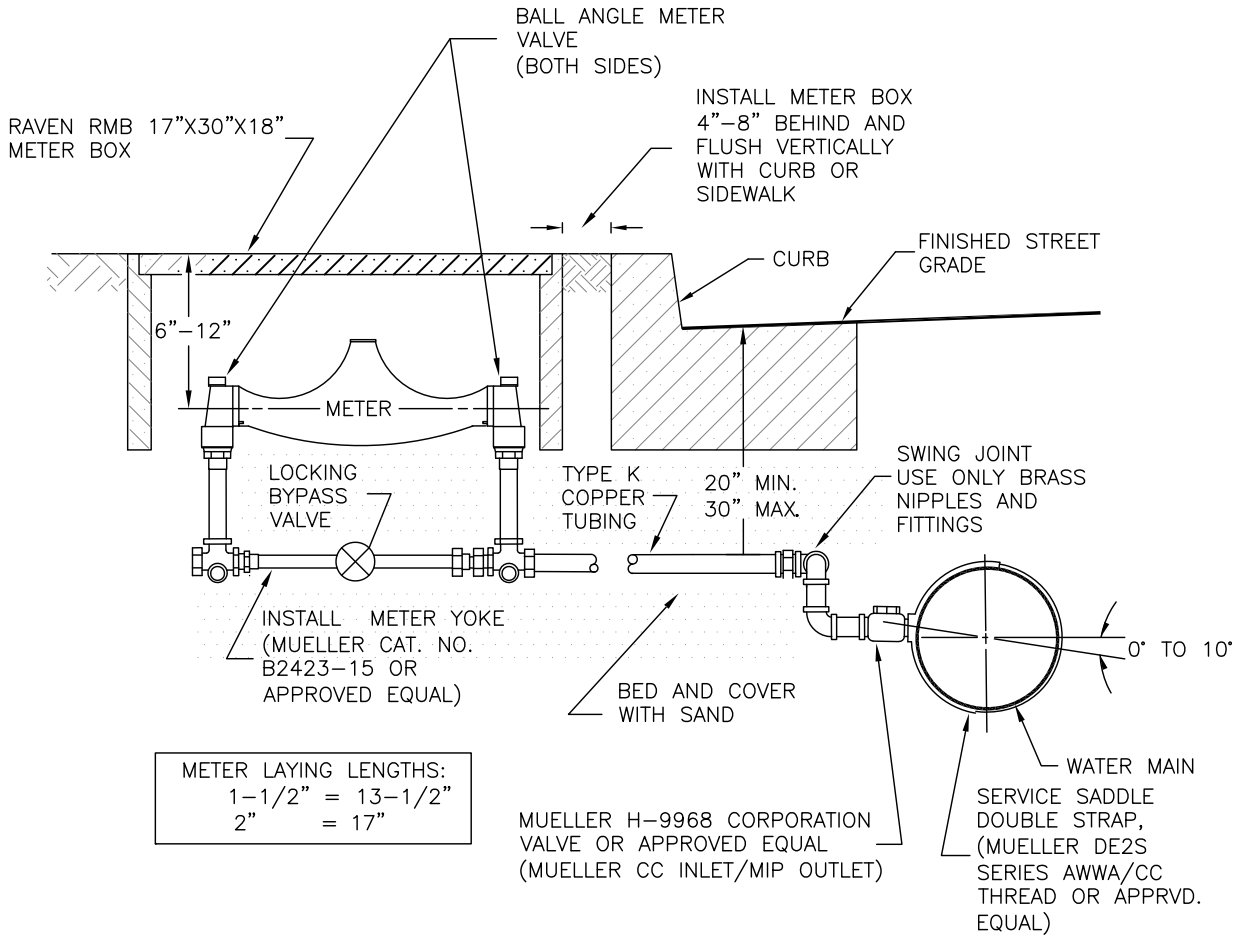


NOTES:

1. METERS 1 1/2" AND LARGER TO BE PROVIDED BY THE CITY AND INSTALLED BY CONTRACTOR.
2. PRIOR TO CITY PROVIDING METER AND CONTRACTOR INSTALLING METER, ALL SERVICE APPLICATIONS MUST BE COMPLETED AND APPROVED. SERVICE FEES PAID IN FULL AND AS–BUILTS SUBMITTED AND APPROVED.
3. CONTRACTOR SHALL CONTACT CITY ENGINEERING DIVISION AT (360) 342–5071, 48 HOURS PRIOR TO INSTALLING ANY WATER SERVICE CONNECTIONS.
4. METERS CANNOT BE SET PRIOR TO DISINFECTION OF THE MAIN AND SERVICE AND PRIOR TO A SUCCESSFUL BACTERIOLOGICAL TEST.
5. WATER SERVICES SHALL BE PRESSURE TESTED ALONG WITH THE MAIN.
6. DURING THE PRESSURE TEST, THE MAIN SHALL BE OPEN FOR INSPECTION OF ALL CORPORATION STOPS.
7. USE 1–7/8" BIT FOR ALL 2" SADDLE TAPS AND 1–3/8" BIT FOR 1–1/2" SADDLE TAPS.
8. METER BOX IS NOT ALLOWED IN HARD SURFACED AREAS WITHOUT PRIOR WRITTEN APPROVAL. METER BOX SHALL BE SLIGHTLY HIGHER (1/8" MAX.) THAN SURROUNDING GRADE AND MADE TO DRAIN AWAY FROM BOX.
9. BROOKS 65 METER BOX AND EXTENSION MAY BE ALLOWED WITH 1–1/2" METER SETS ONLY.

1–1/2" & 2" WATER SERVICE

PLAN #

CITY OF BATTLE GROUND
APPROVED

Ryan M. Jeynes 6/25/25
CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	8/12/98	BSG	GGH
2	4/16/07	JMH	MCH
3	8/7/07	MCH	MCH
4	6/25/25	RMJ	RMJ

WA–2.1