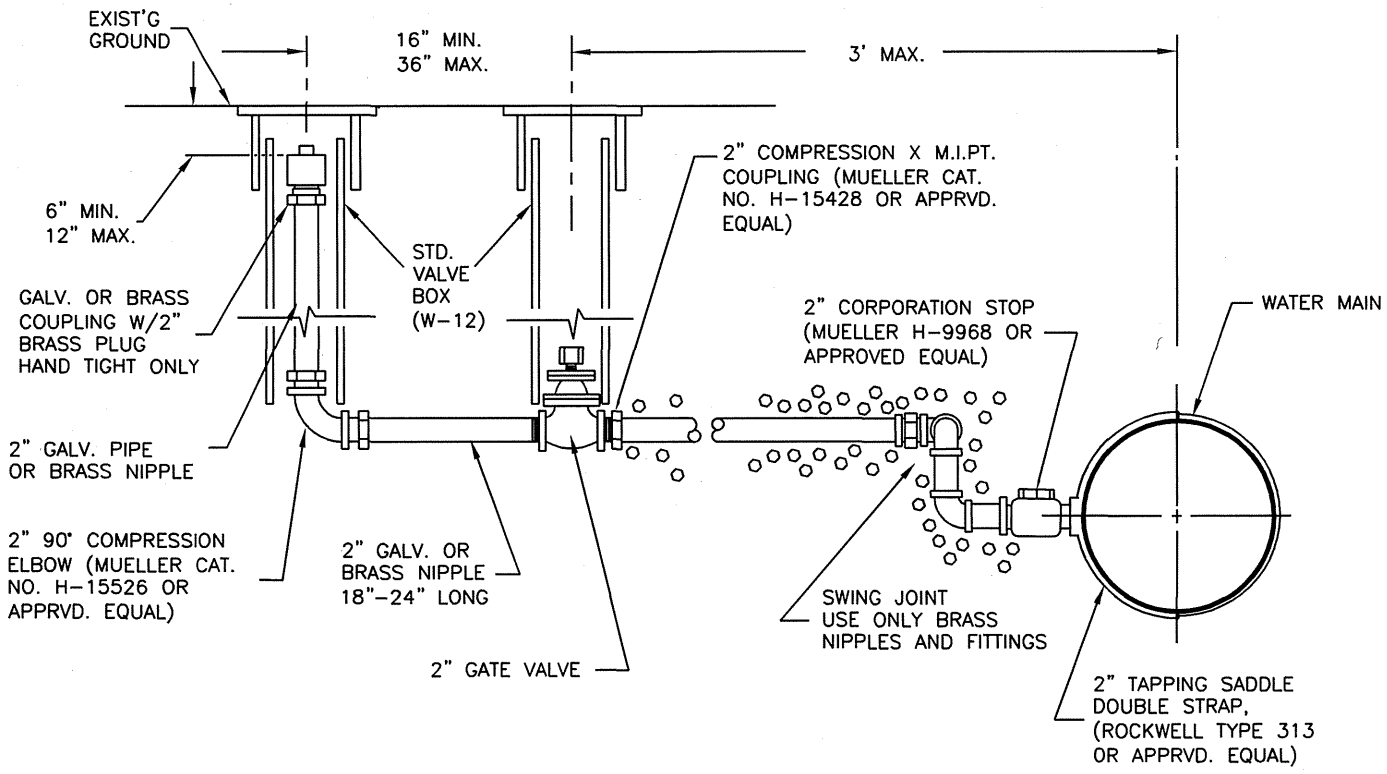



TABLE "A"

| MAIN DIAMETER | BLOW-OFF DIAMETER |
|---|---|
| <12" | 2" MINIMUM |
| ≥12" | 4" MINIMUM |

NOTES:

1. BLOWOFFS SHALL BE INSTALLED 1' FROM THE END OF THE MAIN.
2. (5/8-) GRAVEL SHALL BE USED AS BEDDING AROUND THE SERVICE.
3. ALL PIPING UPSTREAM OF THE 2" GATE VALVE SHALL BE TYPE K COPPER OR BRASS

# STANDARD BLOWOFF ASSEMBLY

PLAN #

CITY OF BATTLE GROUND

CITY OF BATTLE GROUND APPROVED

9/24/07

CITY ENGINEER DATE

| REVISIONS: | DATE: | DRAWN: | DESIGNED: |
|---|---|---|---|
| 1 | 4/16/07 | JMH | MCH |
| 2 | 9/24/07 | MCH | MCH |
| | | | |
| | | | |
| | | | |

WA-4.2