

NON SINGLE-FAMILY WATER METER/DCVA INSTALLATION LOCATION

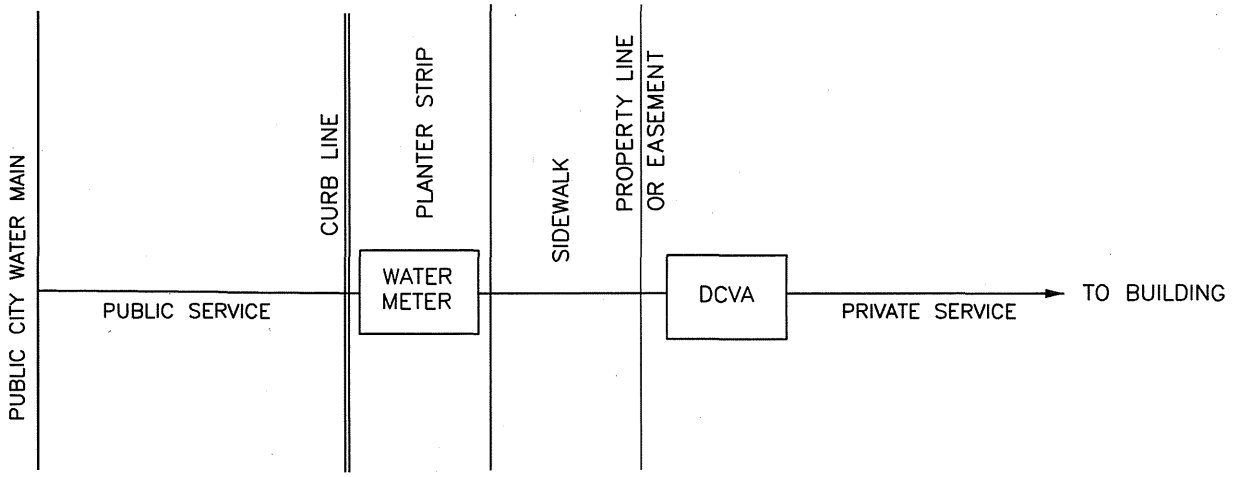

NON SINGLE-FAMILY WATER METER/DCVA INSTALLATION LOCATION W/IRRIGATION LINE

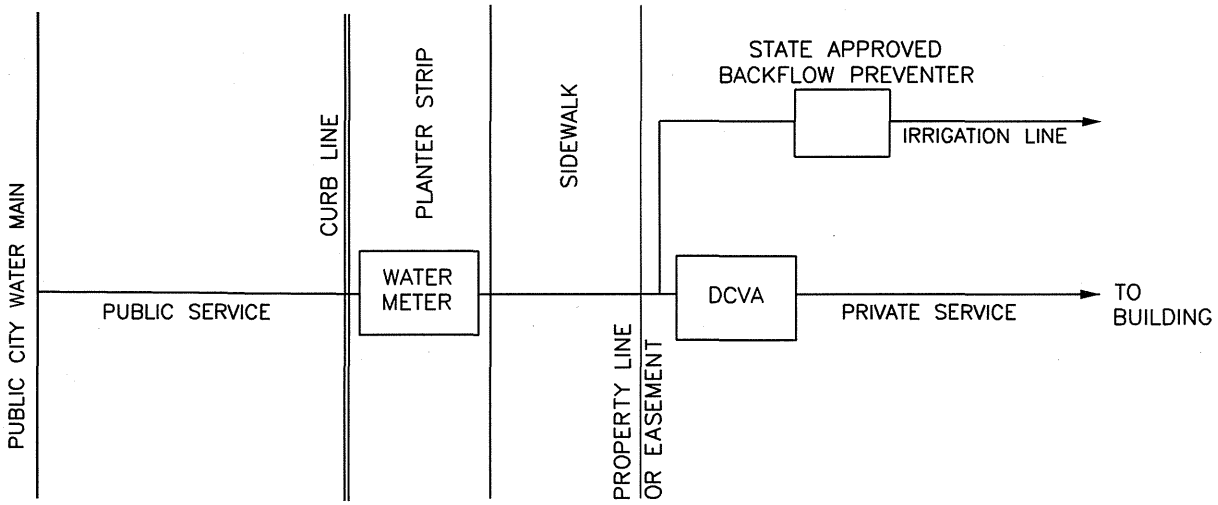

NOTES:

1. DOMESTIC SERVICES SHALL BE TAPPED FROM MAIN LINES AND NOT FROM FIRE PROTECTION OR HYDRANT LINES.
2. AN IRRIGATION PERMIT FROM THE CITY OF BATTLE GROUND IS REQUIRED FOR ALL IRRIGATION SYSTEMS.
3. ALL BACKFLOW DEVICES ARE PRIVATELY OWNED AND MAINTAINED. BACKFLOW DEVICES MUST BE TESTED ANNUALLY BY A CERTIFIED BACKFLOW ASSEMBLY TESTER.

NON SINGLE-FAMILY WATER METER/BACKFLOW INSTALLATION LOCATIONS					PLAN #
THE CITY OF BATTLE GROUND	CITY OF BATTLE GROUND APPROVED CITY ENGINEER 9/24/07 DATE	REVISIONS:	DATE:	DRAWN:	DESIGNED:	WA-6.2
		1	4/16/07	JMH	MCH	
		2	9/24/07	MCH	MCH	